


## Flushing Program – Request for Reduction or Cessation

All flushing programs must begin with a minimum of 1 FLUSH and 3 chlorine residuals PER WEEK and any changes must be approved by the Environmental Services Department before being implemented.

The following flow chart will assist in the determination of flushing program changes. Requests for consideration can be made by email to [watertests@vaughan.ca](mailto:watertests@vaughan.ca).

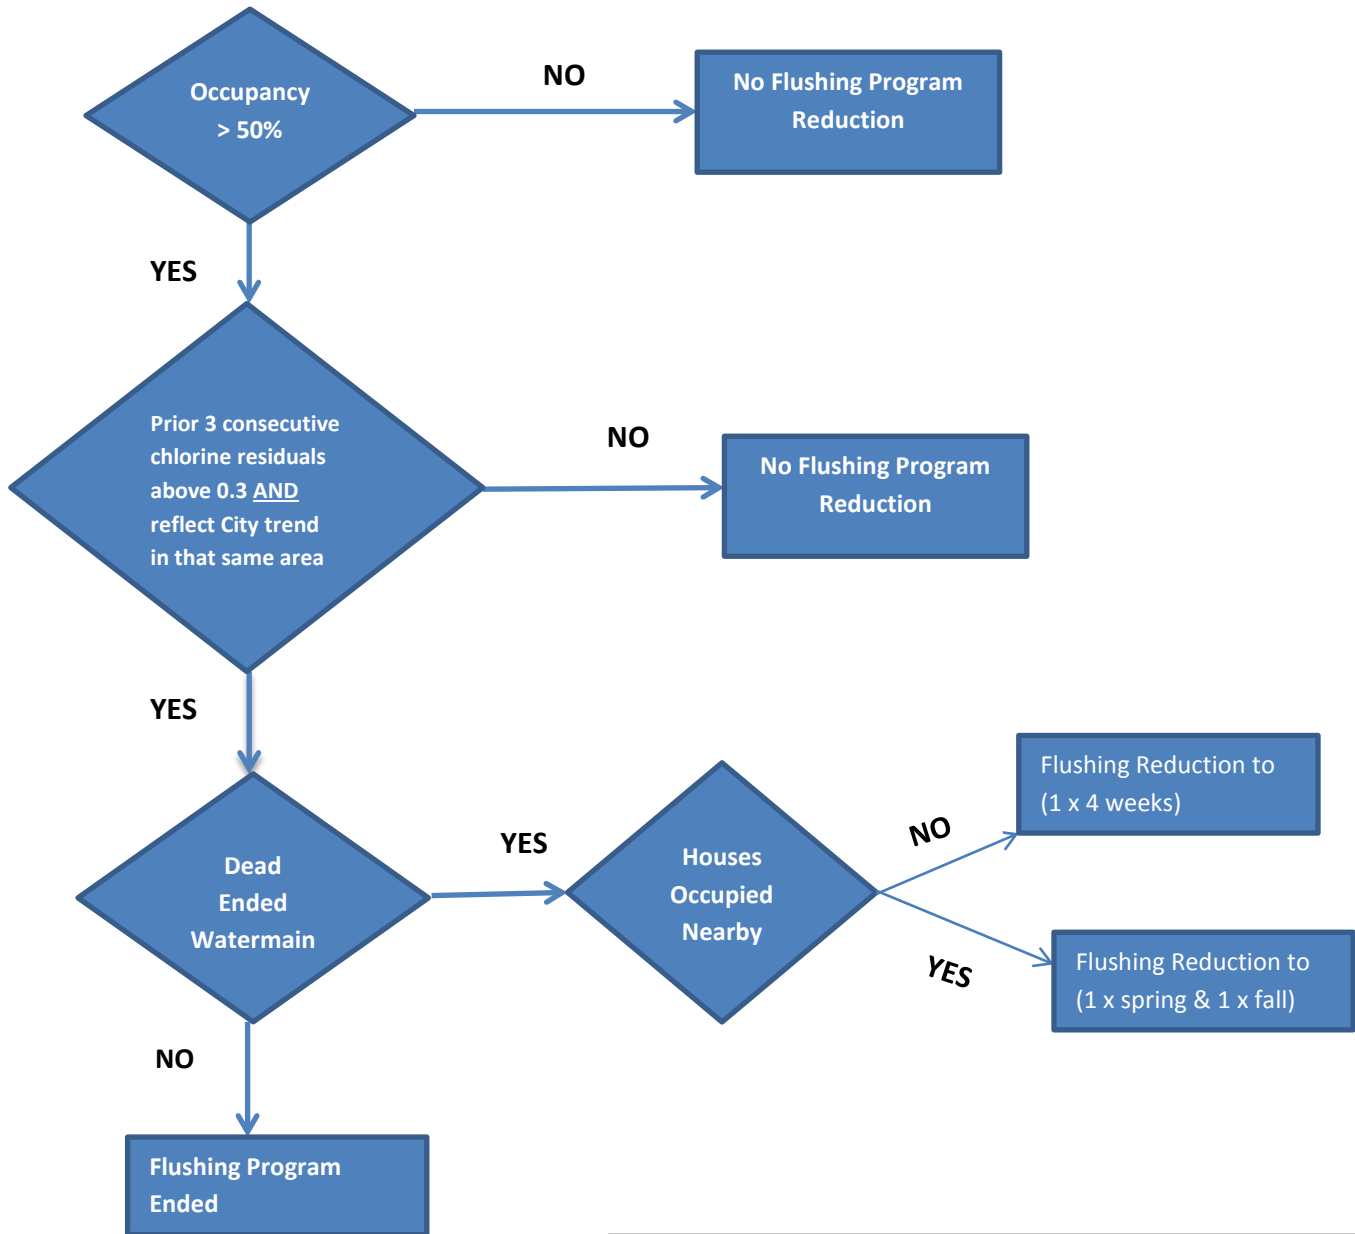

NOTE: The consumption calculation worksheet (FIGURE 3) is required to accompany this request and must show that the watermain can be turned over **within 3 days** for any flushing program reduction or cessation to be approved.