

HERITAGE VAUGHAN REPORT

DATE: Wednesday, May 16, 2018

WARD(S): 2

**TITLE: NEW CONSTRUCTION – DETACHED GARAGE
50 CLARENCE STREET, WOODBRIDGE HERITAGE
CONSERVATION DISTRICT**

FROM:

Jason Schmidt-Shoukri, Deputy City Manager, Planning and Growth Management

ACTION: DECISION

Purpose

To seek a recommendation from the Heritage Vaughan Committee regarding the proposed construction of a detached garage located at 50 Clarence Street, a property located in the Woodbridge Heritage Conservation District “WHCD” and designated under Part V of the *Ontario Heritage Act*.

Report Highlights

- The Owner is proposing a detached garage to be located at 50 Clarence Street.
- The proposal is consistent with the relevant policies of the Woodbridge Heritage Conservation District Plan (“WHCD Plan”).
- Heritage Vaughan review and Council approval is required under the *Ontario Heritage Act*.
- Staff is recommending approval of the proposal as it conforms with the policies of the Woodbridge Heritage Conservation District Plan (“WHCD Plan”).

Recommendations

1. THAT Heritage Vaughan recommend approval to Council for the proposed detached garage at 50 Clarence Street under Section 42 of *Ontario Heritage Act*, subject to the following conditions:
 - a) Any significant changes to the proposal by the Owner may require reconsideration by the Heritage Vaughan Committee, which shall be determined at the discretion of the Director of Development Planning and Manager of Urban Design and Cultural Heritage;
 - b) That Heritage Vaughan Committee recommendations to Council do not constitute specific support for any Development Application under the *Ontario Planning Act* or permits or requirements currently under review or to be submitted in the future by the Owner as it relates to the subject application.

Background

The subject property is municipally known as 50 Clarence Street and is located on the southwest corner of Rosebury Lane and Clarence Street, as shown on Attachment #1. The subject property is noted as a “Contributing” property within the WHCD Plan. The existing one-storey building is identified as a “1940’s cottage” in the WHCD Plan Inventory, and is further noted as being “*heavily modified, new additions and windows*”.

Previous Reports/Authority

Not applicable.

Analysis and Options

Proposed Alterations

The proposal is for a new detached garage located in the rear/side yard of 50 Clarence Street. The garage will be accessed from the existing paved driveway off Rosebury Lane. The main elevation of the garage would face Rosebury Lane and be set back 4.64 m from the property line. The garage will be set back 10.3 m from the existing house and is 3.71 m in height with a gable roof and wood paneled garage doors. The exterior finish is brick veneer and pre-cast corner quoins to match the existing dwelling. The roof material is asphalt shingles.

Minor Variances

The applicant has confirmed with the Zoning Department that no variances will be required for this proposal.

Clarence Street and Park Drive Character Area

The subject property is located within the Clarence Street and Park Drive Character Area of the WHCD. The following is an analysis of the applicable WHCD policies:

5.3.2.5. Circulation, vehicular access and parking

“On-site parking, garages, and parking structures are generally concealed behind or below inhabited buildings.”

- The proposed garage will be located behind the existing contributing building that fronts onto Clarence Street. The garage will be visible from Rosebury Lane, however this property is located on the border of the WHCD boundary, and other properties on Rosebury Lane are not included in the WHCD boundary.

6.1.5 Clarence Street and Park Drive Heritage Attributes – Guidelines:

“1. The Street should retain the existing residential character with a single family detached building type and be designed to support a pedestrian streetscape.”

- The proposed garage will not impact the existing residential character, as the existing single family detached building type will remain and the detached garage will appear as a separate, secondary outbuilding. The proposed garage will be 3.71m in height, which will not impact the existing dwelling which is approximately 4.5m in height.

Section 6.2.8 Appropriate Materials

“Doors: Wood doors and frames, panel construction, may be glazed; transom windows and paired sidelights with real glazing bars; wood french doors for porch entrances; single-bay, wood panelled garage doors.”

- The proposed single-bay insulated steel garage doors will mimic the appearance of wood doors, as shown on the material sample in Attachment #6.

Section 6.6.3 – Tree Canopy and Vegetation – Guidelines:

“3. Trees on public and private property, having a tree diameter of twenty (20) centimetres or more or having a base diameter of twenty (20) centimetres or more, must be conserved, and the requirements of the City of Vaughan Tree Bylaw 185-2007 must be adhered to.”

- The applicant has confirmed that the existing trees on the property will not be removed.

Based on the above analysis, the proposed detached garage is in conformity with the policies of the WHCD Plan.

Timeline

This application is subject to the 90 day review under the *Ontario Heritage Act*. This application was declared complete on March 6, 2018, and must be deliberated upon by June 4, 2018, to meet the 90 day timeline.

Financial Impact

There are no requirements for new funding associated with this report.

Broader Regional Impacts/Considerations

There are no broader Regional impacts or considerations.

Conclusion

The Urban Design and Cultural Heritage Division has reviewed the application to permit a new garage on the property municipally known as 50 Clarence Street and is satisfied that the proposed garage is consistent with the Woodbridge Heritage Conservation District Plan. Accordingly, the Urban Design and Cultural Heritage Division of the Development Planning Department can support the approval of the proposed alteration under Section 42 of the *Ontario Heritage Act*.

For more information, please contact: Shelby Blundell, Cultural Heritage Coordinator, ext. 8813

Attachments

1. Location Map
2. Subject Property
3. Site Photos
4. Site Plan, RN Design Ltd., March 5, 2018
5. Elevations, RN Design Ltd., March 5, 2018
6. Metal Garage Door Material Sample, provided by RN Design Ltd.

Prepared by

Shelby Blundell, Cultural Heritage Coordinator, ext. 8813

/CM

Location Map



Woodbridge HCD (Yellow shaded area)

50 Clarence Street

Attachment 2

Subject Property



Approximate Location of Proposed Garage

Attachment 3



Subject Property from Clarence Street



Existing Driveway – Location of Proposed Garage



Existing Fenced Backyard



Existing Fenced Backyard

File: D:\RN 2018 Projects\18016\Site Planning\Architecture (RN)\Site Plan\18016-SP100.DWG Plotted: Mar 05, 2018 By: MarthaS



Drawing List:

- A0 TITLE SHEET
- A1 FOUNDATION PLAN ELEV 'A'
- A2 REAR ELEVATION 'A'
- A3 FRONT ELEVATION 'A'
- A4 ROOF PLAN ELEV 'A'
- A5 LEFT SIDE ELEVATION 'A'
- A6 RIGHT SIDE ELEVATION 'A'
- D1 CONSTRUCTION NOTES
- D2 CONSTRUCTION NOTES
- D3 CONSTRUCTION NOTES

Areas:

	ELEVATION 'A'	
	SF	SM
GARAGE COVERAGE	438.8	40.76

Steve & Tina Vocella
Detached Garage

I DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN ON BEHALF OF THE BUILDING DEPARTMENT. SECTION-3.2.4 OF THE BUILDING DEPARTMENT REGULATIONS. THE FIRM IS REGISTERED IN THE PROVINCE OF ONTARIO.

**PRELIMINARY-NOT
FOR CONSTRUCTION**

SIGNATURE: _____

client Steve & Tina Vocella					location VAUGHAN				
project Detached Garage					marketing name				
#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	14-FEB-18	KK	MSA					
2	ISSUED FOR CLIENT REVIEW	28-FEB-18	MSA	MSA					
3	REVISED AS PER HCD COMMENTS	5-MAR-18	MSA	MSA					

RN design
Imagine • Inspire • Create





model
DETACHED GARAGE

scale
3/16" = 1'0"

project #
18016

page

A0

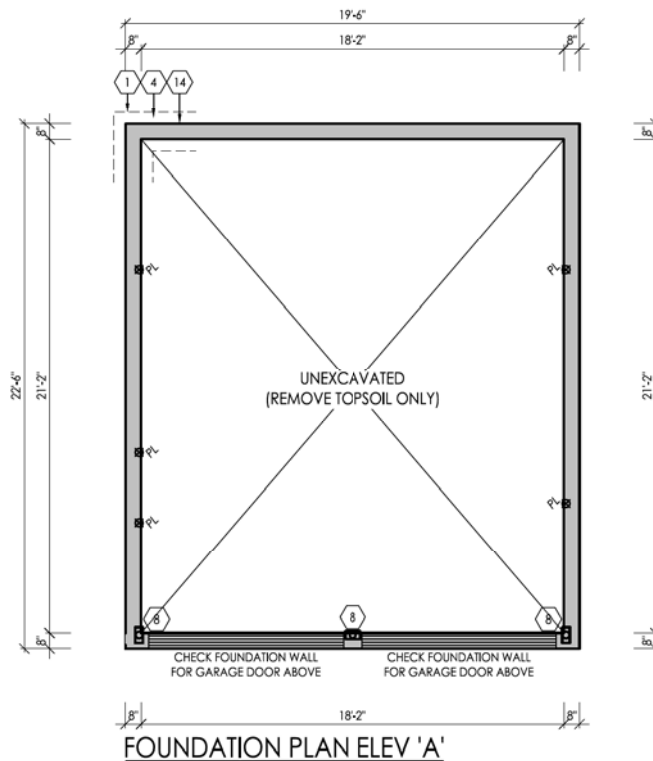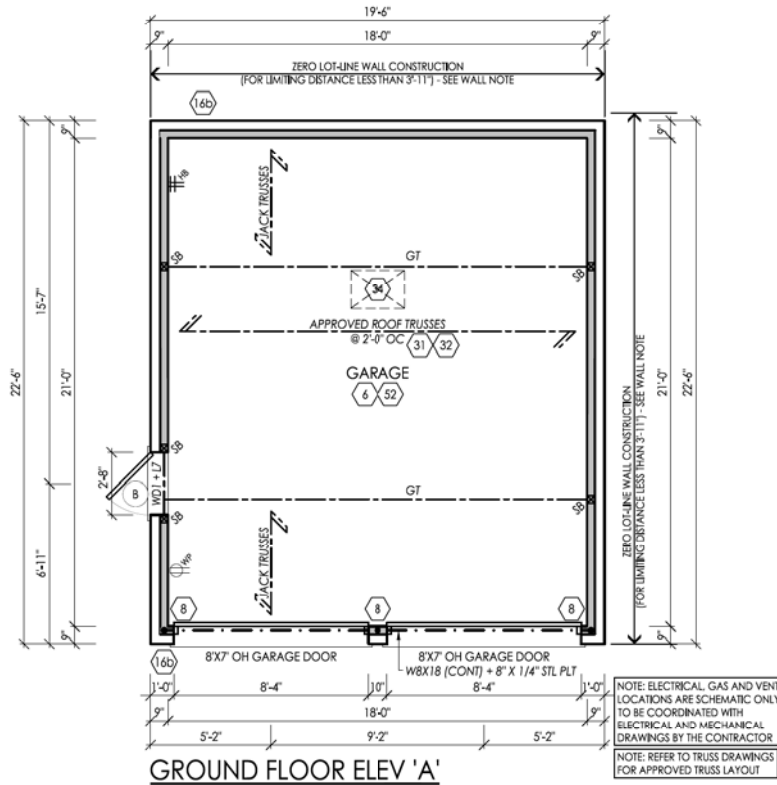

DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN ON BEHALF OF THE BUILDING FIRM. THE FIRM IS RESPONSIBLE FOR THE DESIGN.

PRELIMINARY-NOT FOR CONSTRUCTION

SIGNATURE:

client
Steve & Tina Vocella

project
Detached Garage

location
VAUGHAN

marketing name

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	14-FEB-18	KK	MSA					
2	ISSUED FOR CLIENT REVIEW	28-FEB-18	MSA	MSA					
3	REVISED AS PER HCD COMMENTS	5-MAR-18	MSA	MSA					

RN design
Imagine • Inspire • Create




model
DETACHED GARAGE

scale
3/16" = 1'0"

project #
18016

page

A1

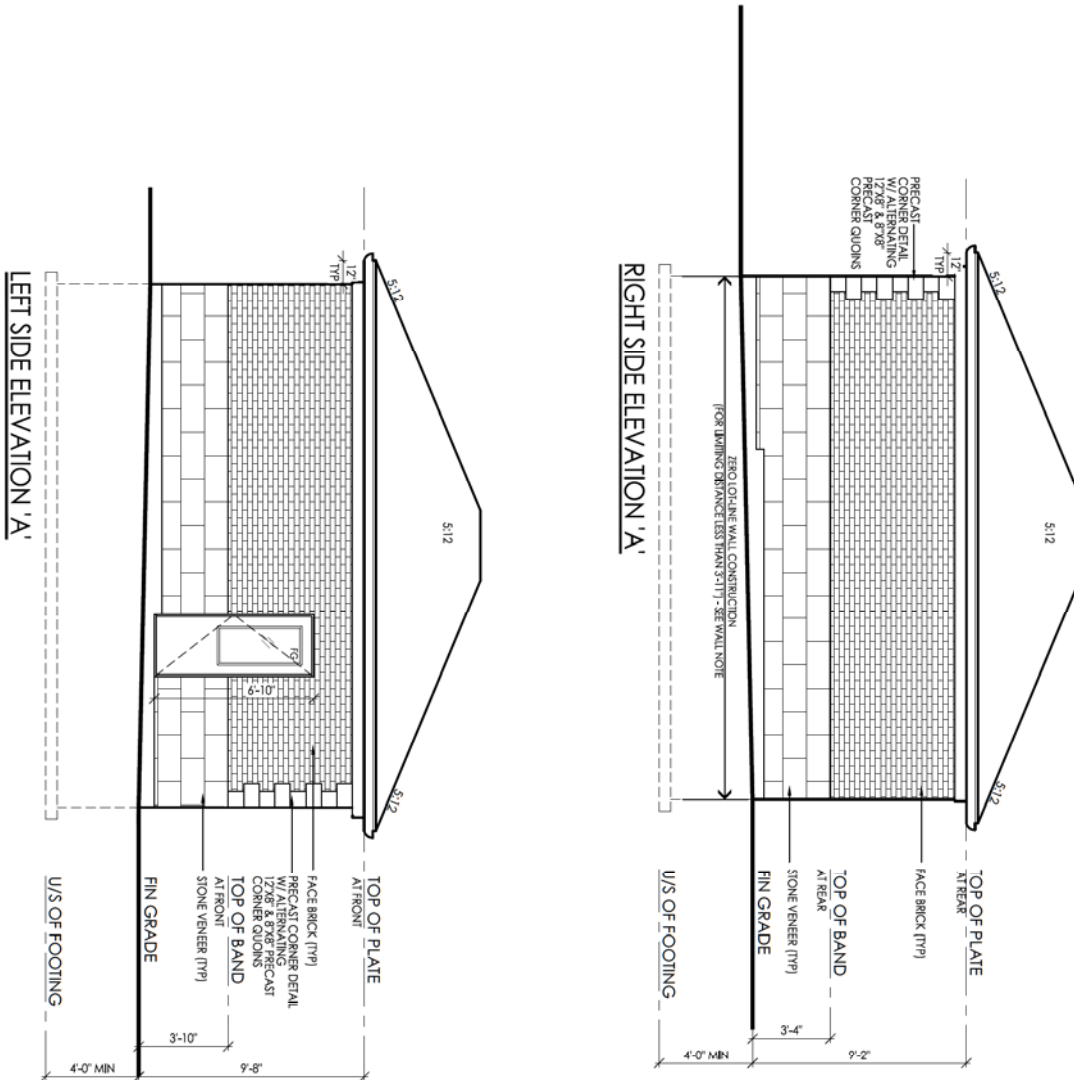

DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN OF THE BUILDING UNDER THE DESIGN PROFESSIONAL SEAL OF THE BUILDING PROFESSIONAL REGISTRATION ACT, 1991. THE FIRM IS REGISTERED WITH THE REGISTRY OF PROFESSIONAL ENGINEERS.

PRELIMINARY-NOT FOR CONSTRUCTION

SIGNATURE:

client					location				
Steve & Tina Vocella					VAUGHAN				
project					marketing name				
Detached Garage									
#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	16-FEB-18	KX	MSA					
2	ISSUED FOR CLIENT REVIEW	28-FEB-18	MSA	MSA					
3	REVISED AS PER HCD COMMENTS	14-MAR-18	MSA	MSA					

RN design
Imagine • Inspire • Create



model
DETACHED GARAGE

scale
3/16" = 1'0"

project #
18016

page

A3

COMPLIANCE PACKAGE A1 - OBC 2012 - 2017 ENACTMENT

(UNLESS OTHERWISE NOTED)
-ALL CONSTRUCTION TO CONFORM TO THE ONTARIO BUILDING CODE (O.B.C.) AND ALL OTHER CODES AND LOCAL AUTHORITIES HAVING JURISDICTION.
-ALL DIMENSIONS GIVEN FIRST IN IMPERIAL FOLLOWED BY METRIC.
-THERMAL RESISTANCE VALUES BASED ON ZONE 1

FOOTINGS / SLABS:

TYPICAL STRIP FOOTING:
O.B.C. 9.15.3.
-BASED ON 16-1/4" (419mm) MAX. SUPPORTED JOIST LENGTH
MIN. 2200psi (15MPa) CONCRETE AFTER 28 DAYS
SHALL REST ON UNFINISHED SOIL, ROCK OR COMPACTED GRANULAR FILL W/ MIN. 10% (75kPa) BEARING CAPACITY
-FIG. 10 HAVE CONTINUOUS KEY
FIG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY (AS PER SOILS ENGINEERING REPORT)
-REFER TO WORKING DRAWINGS FOR SPECIFIC SIZES THAT MAY SUPERSEDE NOTES #1 & #2 FOR FOOTING SIZES

1 TYPICAL STRIP FOOTING: (EXTERIOR WALLS)

O.B.C. 9.15.3.5.
-FIG. 10 TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE
BRICK VENEER -1 STOREY -13" X 4" (330mm X 100mm)
-2 STOREY -14" X 4" (400mm X 150mm)
-3 STOREY -24" X 9" (660mm X 230mm)

SIDING -1 STOREY -10" X 4" (255mm X 100mm)
-2 STOREY -14" X 4" (400mm X 100mm)
-3 STOREY -18" X 5" (460mm X 130mm)

2 TYPICAL STRIP FOOTING: (INTERIOR WALLS)

O.B.C. 9.15.3.6.
-1 STOREY MASONRY -16" X 4" (410mm X 100mm)
-1 STOREY STUD -12" X 4" (305mm X 100mm)
-2 STOREY MASONRY -24" X 9" (650mm X 230mm)
-2 STOREY STUD -18" X 5" (450mm X 130mm)
-3 STOREY MASONRY -36" X 4" (900mm X 360mm)
-3 STOREY STUD -24" X 8" (600mm X 200mm)

3 STEP FOOTING:

O.B.C. 9.15.3.9.
-23 5/8" (600mm) MAX. VERTICAL RISE & 23 5/8" (600mm) MIN. HORIZONTAL RUN.

4 DRAINAGE TILE OR PIPE:

O.B.C. 9.14.3.
-4" (100mm) MIN. DIA. LAID ON UNDISTURBED OR WELL COMPACTED SOIL W/ TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF F.L. SLAB.
-COVER TOP & SIDES OF TILE OR PIPE W/ 5/8" (150mm) OF CRUSHED STONE OR OTHER COURSE CLEAN GRANULAR MATERIAL
-TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL.

5 BASEMENT SLAB:

O.B.C. 9.13. & 9.16.
-3" (75mm) CONCRETE SLAB
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMP-PROOF BELOW SLAB W/ MIN. 0.004" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi (25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-4" (100mm) OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FIG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-R10 (RSI 1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23-1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT LESS THAN 23-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (OBC 5B-12-3.1.1.7 [5])
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD [O.B.C. 38-9]

5a SLAB ON GROUND:

-3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3.
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMP-PROOF BELOW SLAB W/ MIN. 0.004" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi (25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-R10 (RSI 1.76) INSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 23-1/2" (600mm) OF GRADE. (OBC 5B-12.3.1.1.7 [6])
-4" (100mm) OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FIG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD [O.B.C. 38-9]

6 GARAGE SLAB / EXTERIOR SLAB:

-4" (100mm) CONCRETE SLAB
-4650psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR UNREINFORCED CONC. & W/ 5-8% AIR ENTRAINMENT - O.B.C. 9.3.1.6.
-6" X 6" (W2.9 X W 2.9) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB
-4" (100mm) OF COURSE GRANULAR MATERIAL
-ANY FILL PLACED UNDER SLAB, OTHER THAN COURSE CLEAN GRANULAR MATERIAL, SHALL BE COMPACTED.

7 PILASTER:

O.B.C. 9.15.5.3.
-PILASTER
-CONCRETE NBS - 4" X 12" (100mm X 300mm)
-BLOCK NBS - 4" X 12" (100mm X 300mm) BONDED & TIED TO WALL AS PER O.B.C. 9.20.11.2.
-TOP 7/8" (200mm) SOLID.

OR
-BEAM POCKET
-1/2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2)

STRUCTURAL COLUMN
-SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS. WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4kPa).

8 STEEL PIPE COLUMN:

O.B.C. 9.15.3.4. & 9.17.3.
-FIXED COLUMN
-MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS
-FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" 1/4" (152mm X 100mm X 6.35mm) STEEL BIM. PLATE
-FOR WOOD BEAMS, MIN. 4"X4"X1/4" (100mm X 100mm X 6.35mm) STEEL TOP & BIM. PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH OF BEAM
-ADJUSTABLE COUPLERS TO CONFORM TO CAN/CSG-7.2-M WHERE IMPOSED LOAD DOES NOT EXCEED 34 KN (O.B.C. 9.17.3.4)
-COL. SPACING: FIG. SIZE:
2 STOREY
-MAX. 9'-10" (2997mm)
-34" X 34" X 16"
- (840mm X 840mm X 400mm)
-44" X 44" X 21"
- (1120mm X 1120mm X 530mm)
3 STOREY
-MAX. 9'-10" (2997mm)
-40" X 40" X 19"
- (1010mm X 1010mm X 480mm)
-51" X 51" X 24"
- (1295mm X 1295mm X 610mm)
-WHERE COL. SITS ON FDN. WALL: USE 4" X 8" X 5/8" (100mm X 200mm X 16mm) STEEL PLATE WITH 2-5/8" (16mm) ANCHOR BOLTS

CLIENT SPECIFIC REVISIONS

ONTARIO REGULATION 332/12 OBC AMENDMENT O. REG. 139/17 JAN. 1, 2018

FILE: C:\P\Ontario\amp\AC\B\1002\1001\DETACHED GARAGE-RN.dwg Pinned: Nov 16, 2018 by: mshah

DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN IN BEHALF OF RN DESIGN LTD. UNDER THE DESIGNATION 3-2.4 OF THE BUILDING ACT, 1997, AND THE FIRM IS REGISTERED.

PRELIMINARY-NOT FOR CONSTRUCTION

SIGNATURE:

WOOD COLUMN:

OBC 9.17.4.1, 9.17.4.2, & 9.17.4.3.
-5 1/2" x 5 1/2" (140mm x 140mm) SOLID WOOD COLUMN - OR
-3 1/2" x 6" (88mm x 140mm) BUILT UP COLUMN GLUED TOGETHER
W/ 3" (76mm) NAILS SPACED NOT MORE THAN 12" (300mm) APART OR BOLTED TOGETHER W/ 3/8" (9.52mm) DIA. BOLTS SPACED AT 18" (450mm) O.C.
-WRAP COLUMN BASE W/ 6 MIL POLY
-COLUMN TO SIT DIRECTLY ON CONC. PAD [NOT ON CONC. SLAB]
-25"X25"X12" (640mm x 640mm x 300mm) CONC PAD (1 FLOOR SUPPORTED W/ 9'-10" COL. SPACING)
-34"X34"X14" (880mm x 880mm x 360mm) CONC PAD (2 FLOORS SUPPORTED W/ 9'-10" COL. SPACING)

10 BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES)

-7/8"X17" LEDGER BOARD FASTENED W/ 2/1" ANCHOR BOLTS @ 4' O.C.
-WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 11
-WHERE REQUIRED TO OBTAIN 5' SEPARATION DISTANCE BETWEEN ADJACENT BEAMS

11 BLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM)

-12X17X 5/8" SFL. PLATE ON TOP OF SOLID CONCRETE BLOCK WITH 2-1/2"X8" ANCHOR BOLTS.

WALL ASSEMBLIES:

14 FOUNDATION WALL:

O.B.C. 9.15.4.2.
-FOR WALLS NOT EXCEEDING 8'-2" (2500mm) IN LATERALLY SUPPORTED HEIGHT.
-4" (100mm) SOLID 2200psi (15MPa) CONCRETE
-MAX. UNSUPPORTED HEIGHT OF 3'-11" (1200mm) & MAX. SUPPORTED HEIGHT OF 7'-0" (2100mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
-FOR WALLS NOT EXCEEDING 9'-2" (2750mm) IN LATERALLY SUPPORTED HEIGHT.
-10" (250mm) SOLID 2200psi (15MPa) CONCRETE
-MAX. UNSUPPORTED HEIGHT OF 4'-7" (1400mm) & MAX. SUPPORTED HEIGHT OF 8'-4" (2600mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
-LATERAL SUPPORT PROVIDED BY ANCHORED SILL PLATE TO JOISTS.
-FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN CONFORMANCE TO O.B.C. -19.15.4.2.A. SHALL BE USED OR IT SHALL BE DESIGNED UNDER O.B.C. -PART 4
-WALL SHALL EXTEND A MIN. 5/8" (150mm) ABOVE GRADE
-INSULATE W/ R20 (RSI 3.52) CONTINUOUS INSULATION FROM UNDERSIDE OF SUBFLOOR TO NOT MORE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT (ZONE 1 OBC 5B-12.3.1.1.2.A.)
-ALTERNATE INSULATION METHOD: 2" (51mm) R10 (RSI 1.76) RIGID INSULATION W/ 2"x4" (88mm X 89mm) WOOD STUD W/ R12 (RSI 2.11) BATT INSULATION
-BACK FILL W/ NON-FROST SUSCEPTIBLE SOIL
-REDUCTION OF THICKNESS:
O.B.C. 9.15.4.7.
-WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FINISH, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS THAN 3-1/2" (90mm) THICK.
-TIE TO FACING MATERIAL WITH METAL LIES SPACED MAX. @ 7/8" (200mm) VERTICALLY O.C. & 2'-11" (600mm) HORIZONTALLY.
-FILL SPACE BETWEEN WALL AND FACING SOIL TO BE HORTAR
-WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK

DAMP-PROOFING & WATERPROOFING:

-DAMP-PROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 9.13.2.
-WHERE INSULATION EXTENDS TO MORE THAN 2'-11" (900mm) BELOW GRADE, A FDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1.2 [9] [16]
-FINISHED BASEMENTS SHALL HAVE INTERIOR DAMP-PROOFING EXTENDING FROM SLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.3 [9]
-WHERE HYDROSTATIC PRESSURE OCCURS, FDN. WALLS SHALL BE WATERPROOFED AS PER O.B.C. 9.13.3.
-WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMP-PROOFING.

14a FOUNDATION WALLS @ UNSUPPORTED OPENINGS:

-2-20M BARS IN TOP PORTION OF WALL [UP TO 8'-0" OPENING]
-3-20M BARS IN TOP PORTION OF WALL [8'-0" TO 10'-0" OPENING]
-4-20M BARS IN TOP PORTION OF WALL [10'-0" TO 15'-0" OPENING]
-BARS STACKED VERTICALLY AT INTERIOR FACE APPROX 4" TO 6" APART.
-BARS TO HAVE MIN. 2' (600mm) CONCRETE COVER
-BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING.

15 FRAME WALL CONSTRUCTION:

O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.2B.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
-2" X 4" (88mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION [ZONE 1 - OBC 5B-12.3.1.1.2.A.]
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
-NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 4" (88mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 5B-3 WALL - EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING MATERIALS:
-REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 1/2" (12.7mm) TYPE 'X' GYPSUM BOARD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

-REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
OR
-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

15a ALTERNATE FRAME WALL CONSTRUCTION:

O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.2B.1.4. & 9.27.1)
-1 1/2" (38mm) RB (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.2)
-BRACE W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BIM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (88mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BIM. PLATE FOR FULL LENGTH OF WALL.
-2" X 4" (88mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS.
-R14 (RSI 2.46) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. -9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD.
-NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (88mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (88mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 5B-3 WALL - EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. BETWEEN RIGID INSULATION AND WOOD STUD.
-REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

-REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
OR
-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING ON EXTERIOR SIDE OF RIGID INSULATION

15b FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.2B.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
-2" X 4" (88mm X 89mm) WOOD STUDS @ 16" (400mm) O.C.
-1/2" (12.7mm) GYPSUM BOARD
-NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (88mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (88mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 5B-3 WALL - EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.
-REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

-REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
OR
-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

16 BRICK VENEER CONSTRUCTION:

O.B.C. 9.23.
-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BIM. COURSE & OVER OPENINGS
-BASE FLASHING UP TO 5/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
-BRICK OR STONE SELLS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
-2" X 4" (88mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION [ZONE 1 - OBC 5B-12.3.1.1.2.A.]
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. -9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
-NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (88mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 5B-3 WALL - EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

16a ALTERNATE BRICK VENEER CONSTRUCTION:

O.B.C. 9.23.
-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BIM. COURSE & OVER OPENINGS
-BASE FLASHING UP TO 5/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
-BRICK OR STONE SELLS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-1/2" (12.7mm) RB (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.2)
-2" X 4" (88mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS
-BRACE W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BIM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (88mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BIM. PLATE FOR FULL LENGTH OF WALL
-R14 (RSI 2.46) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. -9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
-NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (88mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (88mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 5B-3 WALL - EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. BETWEEN RIGID INSULATION AND WOOD STUD.
-REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

16b BRICK VENEER CONSTRUCTION @ GARAGE:

O.B.C. 9.23.
-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BIM. COURSE & OVER OPENINGS
-BASE FLASHING UP TO 5/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
-BRICK OR STONE SELLS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
-2" X 4" (88mm X 89mm) WOOD STUDS @ 16" (400mm) O.C.
-1/2" (12.7mm) GYPSUM BOARD
-NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (88mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (88mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY INSPECTION PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

client					location								
Steve & Tina Vocella					VAUGHAN								
project					marketing name								
Detached Garage													
#	revisions			date	dwn	chk	#	revisions			date	dwn	chk
1	ISSUED FOR CLIENT REVIEW			14-FEB-18	EX	MSA							
2	ISSUED FOR CLIENT REVIEW			28-FEB-18	MSA	MSA							
3	REVISED AS PER HCD COMMENTS			5-MAR-18	MSA	MSA							

Imagine - Inspire - Create

DETACHED GARAGE

scale 3/16" = 1'0"

project # 18016

page

D1

- REG. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):
O.B.C. SB-3 WALL = EW1B (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD
THE FOLLOWING MATERIALS:
-ADD R15 (RSI 2.64) ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/
sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.
- 17 INTERIOR STUD WALLS:**
O.B.C. 1.9.23.10.1.
-2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DOUBLE 2" X 4" OR 2" X 6" TOP PLATES AND SINGLE BOTTOM PLATE
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
- 18 BEARING STUD WALL (BASEMENT):**
-2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DBL. 2" X 4" OR 2" X 6" TOP PLATE
-2" X 4" OR 2" X 6" BOTTOM PLATE ON DAMPROOFING MATERIAL
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C.
-FOOTING AS PER GENERAL NOTE #2 W/ 4" CONC. CURB
- 19 PARTY WALL - BLOCK:**
O.B.C. SB-3 WALL = B6c (STC = 57, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS
TO THE U/S OF ROOF DECK
SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/
MINERAL WOOL OR NON-COMBUSTIBLE MATERIAL & CAULKED TO PREVENT
SMOKE PASSAGE
-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS BOTH SIDES
-2" X 2" (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH
SIDES
-ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE
CAVITY.
-7 1/2" (190mm) HOLLOW BLOCK (NOMIAL WEIGHT AGGREGATE)
STAGGER JOISTS & BEAMS MIN. 3 1/2" (90mm) @ PARTY WALLS AS PER
O.B.C. 9.10.9.1(1) & TABLE 2.1.1.5B-2
-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE [2] TO TABLE 1)
- 19a PARTY WALL - BLOCK (AGAINST GARAGE):**
O.B.C. SB-3 WALL = B5c (STC = 51, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-2" X 6" (38mmX 140mm) WOOD STRAPPING @ 16" (400mm) O.C.
-R22 (RSI 3.52) RIGID INSULATION
-7 1/2" (190mm) HOLLOW BLOCK (NOMIAL WEIGHT AGGREGATE)
-1/2" (12.7mm) GYPSUM BOARD W/ WALL & U/S OF CEILING BETWEEN
HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
- 20 FIREWALL:**
O.B.C. 9.10.11.1 & 3.1.10. & SB-3 WALL = B6a (STC = 57, FIRE = 2 HR)
-ONE FIREWALL IS REQUIRED FOR EVERY 6400 S.F. (600 SQ.M) OF BUILDING
AREA, O.B.C. 1.3.2.2.47.
-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS
-2" X 2" (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES
OF WALL
SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY
7 1/2" (190mm) CONC. BLOCK, MIN. 2 HR. FIRE-RESISTANT RATING
EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS
STAGGER JOISTS & BEAMS MIN. 3" (100mm) @ FIRE WALLS AS PER
O.B.C. 9.10.9.1(1) & TABLE 2.1.1.5B-2
-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE [2] TO TABLE 1)
-PROTRUDE PAST FASCIA & EAVES W/ BRICK CORBELLING
-EXTEND 5/8" (15.9mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/
THROUGH WALL FLASHING PER O.B.C. 3.1.10.4.1(1)
-WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER
THAN 9" (230mm), WALL NEED NOT EXTEND PAST UPPER ROOF SURFACE PER
O.B.C. 3.1.10.4.1(2)
- 20 PARTY WALL - FOUNDATION:**
O.B.C. 9.15.4.2.
-7 1/8" (200mm) SOLID CONC. FOUNDATION WALL @ 2200psi (15MPa)
COMPRESSIVE STRENGTH AFTER 28 DAYS
-FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2
- 21 PARTY WALL - WOOD STUD:**
O.B.C. SB-3 WALL = W13a (STC = 57, FIRE = 1 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF
FOOTINGS TO THE U/S OF ROOF DECK
-2 ROWS 2X4 (38mmX 89mm) STUDS @ 16" (400mm) O.C. W/ SEPARATE
2" X 4" (38mmX 89mm) BOTTOM PLATE & SEPARATE DOUBLE 2" X 4"
(38mmX 89mm) TOP PLATES
SOUND ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF
90% OF THE CAVITY.
-5/8" (16mm) TYPE 'X' GYPSUM BOARD BOTH SIDES W/ JOINTS TAPED &
FILLED.
-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE [2] TO TABLE 1)
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE
REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE
REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-IF 2X6 STUDS USED AS AT STAIR OPENING CONTINUE TO USE
ON REMAINING FLOORS AT THE STAIR OPENING AT 16" O.C.
- 22 GARAGE WALL & CEILING:**
O.B.C. 9.10.9.14(3)
-1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF WALL & U/S OF
CEILING BETWEEN HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
-R22 (RSI 3.87) INSULATION IN WALLS
-R31 (RSI 5.41) INSULATION IN CEILINGS W/ FLOOR ABOVE
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4. FOR FLOOR ABOVE
-INSULATION AROUND DUCTS AND PIPING NOT TO ENCRUST MIN.
REQUIRED GARAGE AREA (REFER TO MUNICIPAL STANDARDS)
-1/2" (12.7mm) GYPSUM BOARD
-ROOF FRAMING MEMBERS ARE FASTENED TO TOP PLATES WITH
4 - 3 1/4" (82mm) TOE NAILS
-BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS, BLOCKING OR
RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7' 7/8" (200mm) O.C.
- 22a WALLS ADJACENT TO ATTIC SPACE:**
-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C.
-R22 (RSI 3.87) INSULATION
-1/2" (12.7mm) GYPSUM BOARD OR 1/4" (6mm) PLYWOOD SHEATHING
ON ATTIC SIDE.
-ATTIC ACCESS TO BE PROVIDED AS PER O.B.C. 9.19.2.1.
- 23 DOUBLE VOLUME WALLS:**
O.B.C. 9.23.10.1.
-3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING
REFER TO PLAN FOR STUD SPECIFICATION
STUDS FASTENED AT TOP & BOTTOM WITH 3 1/4" (82mm) TOE NAILS
-DOUBLE TOP PLATES FASTENED TOGETHER WITH 5" (127mm) AT
7' 7/8" (200mm) O.C.
-SOLID BRIDGING AT 3'-11" (1200mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION (ONE SB 12.3.1.1.2.A.)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
- ◆ CLIENT SPECIFIC REVISIONS

- 24 EXPOSED FLOOR:**
FLOOR AS PER NOTE # 28
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-R31 (RSI 5.46) INSULATION
-VENTED ALUMINUM SOFFIT
- 24a SUNKEN FINISHED AREAS:**
-USE SOLID BUILT-UP WOOD BEARING POST TO SUPPORT SUNKEN AREA
AT FOUNDATION WALLS, EXTEND FOOTINGS TO SUPPORT POSTS.
-WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION
WALLS INSTEAD OF USING BEARING POSTS.
-FLOOR STRUCTURE AS PER NOTE # 28.
- 25 DOUBLE MASONRY WYTHE WALL:**
O.B.C. 9.20.8.2.
-3 1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3 1/2" MASONRY VENEER
-WYTHES TO BE TIED W/ METAL TIES INSTALLED AS PER O.B.C. 9.20.9.4.
-SILL PLATE REQUIRED FOR ROOF AND CEILING FRAMING MEMBERS
-6" SILL W/ 2" BEARING ON EACH SIDE & ANCHOR BOLTS @ 4'-0" O.C.
NOTE: MASONRY TO BE SOLID & MORTAR JOINT FILLED SOLID FOR FLOOR
JOISTS BEARING ON WYTHES. FLOOR JOISTS ARE NOT TO PROJECT INTO CAVITY
AREA.
- 25a CORREL MASONRY VENEER:**
-MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.1(1)
- FLOOR ASSEMBLIES:**
- 26 SILL PLATE:**
O.B.C. 9.23.7.
-2" X 4" (38mm X 89mm) PLATE
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C. FASTENED TO
PLATE W/ NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN 4"
(100mm) INTO FOUNDATION WALL.
-SILL PLATE TO BE CAULKED, OR PLACED ON A LAYER NOT LESS THAN 1"
(25mm) THICK BEFORE COMPRESSION, OR FOAM GASKET, OR PLACED
ON FULL BED OF MORTAR.
- 27 BRIDGING & STRAPPING:**
O.B.C. 9.23.9.4.
a) STRAPPING
-1" X 3" (19mmX 64mm) NAILED TO U/S OF JOISTS @ MAX. 6'-11" (2100mm) O.C.
-FASTENED TO SILL OR HEADER @ ENDS
b) BRIDGING
-1" X 3" (19mmX 64mm) OR 2" X 2" (38mmX 38mm) CROSS BRIDGING @ MAX.
6'-11" (2100mm) O.C.
c) BRIDGING & STRAPPING
-a) & b) USED TOGETHER OR
1 1/2" (38mm) SOLID BLOCKING @ MAX. 6'-11" (2100mm) O.C. USED WITH
STRAPPING (a)
d) FURRING OR PANEL TYPE CEILING
STRAPPING NOT REQUIRED IF FURRING STRIPS OR PANEL TYPE CEILING FINISH
& ATTACHED DIRECTLY TO JOISTS.
- 28 FLOOR ASSEMBLY:**
O.B.C. 9.23.14.3, 9.23.14.4
-5/8" (15.9mm) WAFERBOARD (R-1 GRADE) OR EQUIVALENT
-FLOOR JOISTS AS PER FLOOR PLANS
- 29 PORCH SLAB:**
O.B.C. 9.39.1.4.
-4' 7/8" (125mm) 4650 psi (32 MPa) CONC. SLAB WITH 5 TO 8% AIR ENTRAINMENT
-REINFORCE WITH 10M BARS @ 7' 7/8" (200mm) EACH WAY
-1 1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB
-3" (75mm) END BEARING ON FOUNDATION WALL
-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C.
-IF A COLD CELLAR IS LOCATED BELOW THE SLAB, SUPPORT ON FOUNDATION
WALLS NOT TO EXCEED 8'-2"
- 30 EXTERIOR BALCONY ASSEMBLY:**
-1 1/4" X 3 1/2" PRESSURE TREATED DECKING W/ 1/4" SPACING
-2X4 WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. LAYING UNFASTENED
ON SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT ON 5/8"
(15.9mm) EXTERIOR GRADE PLYWOOD SHEATHING ON 2X4 WOOD PURLINS
(CUT DIAGONALLY) @ 12" O.C. DIRECTLY ON 2X8 ROOF JOISTS @ 12" O.C.
(OR AS NOTED ON PLAN)
-EXTERIOR GUARD AS PER #30a
-SLOPE ASSEMBLY MINIMUM 2% TO ROOF SCUPPER
REQUIRED FOR OVER HEATED SPACES:
-ADD 2X2" (38mm X 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR
VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF
CEILING AREA)
-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS
-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 1.9.29.5.3)
- 30a EXTERIOR FLAT ROOF ASSEMBLY:**
-SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT
INSTALLED PER MANUFACTURER'S SPECIFICATIONS
-1/4" EXTERIOR GRADE WOOD PANEL TYPE UNDERLAY TAPEDED PURLINS
SLOPED MIN. 2% TO ROOF SCUPPER
-3/8" EXTERIOR GRADE PLYWOOD SHEATHING ON
2X8 ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN)
REQUIRED FOR OVER HEATED SPACES:
-ADD 2X2" (38mm X 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR
VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF
CEILING AREA)
-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS
-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 1.9.29.5.3)
- ROOF ASSEMBLIES**
- 31 TYPICAL ROOF:**
O.B.C. 9.26.
-NO. 210 (30. SKG/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO
EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM EDGE TO A LINE NOT
LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION LAD BENEATH STARTER STRIP.
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES.
-STARTER STRIP AS PER O.B.C. 9.26.7.2.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
-3/8" (10mm) PLYWOOD SHEATHING OF OSB (P-2 GRADE) WITH 1" CLIPS
-APPROVED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO MANUFACTURER'S
LAYOUT)
-TRUSS BRACING AS PER TRUSS MANUFACTURER
-EAVESTROUGH ON PREFINISHED FASCIA AND VENTED SOFFIT (VINYL OR
ALUMINUM)
-ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH, 50% AT SOFFIT.
- 32 CEILING:**
-R60 (RSI 10.56) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 1.9.29.5.3)
- 32a VAULTED OR CATHEDRAL CEILING:**
O.B.C. 9.26. & TABLE A4
-NO. 210 (30. SKG/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO
EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM EDGE TO A LINE NOT
LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION LAD BENEATH STARTER STRIP.
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES OR WHERE
ROOF SLOPES ARE 8:12 OR GREATER PER O.B.C. 9.26.5.1.
-STARTER STRIP AS PER O.B.C. 9.26.7.2.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
-3/8" (10mm) PLYWOOD SHEATHING OF OSB (P-2 GRADE) WITH 1" CLIPS.

- 2X8" (38mm x 184mm) @ 16" O.C. W/ 2X2" (38mm x 38mm) CROSS
PURLINS @ 24" O.C. MAX. SPAN 13'-3" (4050mm) OR
-2X10" (38mm x 235mm) @ 16" O.C. W/ 2X2" (38mm x 38mm) CROSS
PURLINS @ 24" O.C. MAX. SPAN 17'-0" (5180mm)
-R31 (RSI 5.46) INSULATION
-MIN. 3" CLEARANCE FROM U/S OF ROOF SHEATHING TO INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH
O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
- 33 CONVENTIONAL FRAMING:**
O.B.C. TABLE A6 OR A7
-2" X 6" (38mm X 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9"
(3890mm)
-2X4" (38mm X 89mm) COLLAR TIES AT MIDSPANS
-CEILING JOISTS TO BE 2" X 6" (38mmX 140mm) @ 16" (400mm) O.C.
-UNLESS OTHERWISE NOTED
-HIF & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON
RAFTERS & MIN. 1 1/2" (38mm) THICK.
- 34 ATTIC ACCESS HATCH:**
OBC 9.19.2.1. & SB-12.3.1.1.8.(1)
-19 3/4" X 27 1/2" (500mm X 700mm) ATTIC HATCH WITH
WEATHERSTRIPPING & BACKED W/ R20 (RSI 3.52) INSULATION.
- GENERAL:**
- 35 PRIVATE STAIRS:**
O.B.C. 9.8.4.
-MAX. RISE = 7' 7/8" (200mm)
-MIN. RUN = 8' 1/4" (210mm)
-MIN. TREAD = 9' 1/4" (235mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-5" (195mm)
-MIN. WIDTH = 2'-10" (660mm)
(BETWEEN WALL FACES)
-MIN. WIDTH = 2'-11" (900mm)
(EXIT STAIRS, BETWEEN GUARDS)
-ANGLED TREADS:
-MIN. RUN = 5' 7/8" (150mm)
-MIN. AVG. RUN = 7' 7/8" (200mm)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-EXTERIOR CONC. STEPS TO HAVE MIN. 9' 1/4" (235mm) TREAD &
MAX. 7/8" (200mm) RISE
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE
- HANDRAILS:**
O.B.C. 9.8.7
-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)
-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)
-ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN
DWELLING UNITS
-HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOOR
WAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION
- HEIGHT:**
O.B.C. 9.8.7.4
-2'-10" (665mm) MIN. TO 3'-2" (965mm) MAX.
-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A
STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING
- PROJECTIONS:**
O.B.C. 9.8.7.6
-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP
STRONGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED
WIDTH OF THE STAIR
- 35a PUBLIC STAIRS:**
O.B.C. 9.8.4.
-MAX. RISE = 7' 3/32" (180mm)
-MIN. RUN = 11" (280mm)
-MIN. TREAD = 11" (280mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-9" (2050mm)
-MIN. WIDTH = 2'-11" (900mm)
(EXIT STAIRS, BETWEEN GUARDS)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE
- HANDRAILS:**
O.B.C. 9.8.7
-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)
-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)
-TWO HANDRAILS ARE REQUIRED ON CURVED STAIRS OF ANY WIDTH
-HANDRAILS ARE TO BE CONTINUOUS INCLUDING AT LANDINGS EXCEPT
WHERE INTERRUPTED BY DOOR WAYS OR NEWEL POSTS AT CHANGES IN
DIRECTION
- HEIGHT:**
O.B.C. 9.8.7.4
-2'-10" (665mm) MIN. TO 3'-2" (965mm) MAX.
-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A
STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING
- PROJECTIONS:**
O.B.C. 9.8.7.6
-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP
STRONGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED
WIDTH OF THE STAIR
- TERMINATION:**
O.B.C. 9.8.7.3
-ONE HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4"
(300mm) BEYOND THE TOP & BOTTOM OF EACH STAIR
- FINISH:**
O.B.C. 9.8.9.6
-TREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE
FROM DEFECTS PER OBC 9.8.9.6.4)
-STAIRS AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE
VISUAL PATTERN TO DEMARKATE THE LEADING EDGE OF THE TREADS,
LANDINGS AND THE BEGINNING AND END OF A RAMP
- 36 INTERIOR GUARDS:**
O.B.C. SB-7 & 9.8.8.3.
-GUARDS TO BE 3'-5" (1070mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-INCLUDES WINDOWS OVER STAIRS, RAMPS AND LANDINGS
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-GUARDS FOR FLIGHTS OF STAIRS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH
- 36a EXTERIOR GUARDS:**
O.B.C. SB-7 & 9.8.8.3.
-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN
23 5/8" (600mm).
-GUARDS TO BE 3'-5" (1070mm)
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE 3'-5" (1070mm) HIGH WHERE WALKING
SURFACE IS MORE THAN 5'-11" (1800mm) ABOVE ADJACENT GRADE.
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-PROVIDE MID-SPAN POSTS AS PER SB-7
-GUARDS FOR FLIGHTS OF STAIRS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH
- THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE
VERIFIED BY CONTRACTOR PRIOR TO CONSTRUCTION. IN THE EVENT OF ANY WORK,
ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

\\C:\Users\pdonado\app\Acrobat\PDFS\1801-DETACHED GARAGE-RN.dwg Pinned: Nov 01, 2018 by method

I DECLARE THAT I HAVE REVIEWED AND TAKEN
DESIGN RESPONSIBILITY FOR THE DESIGN AND CONSTRUCTION OF THIS PROJECT.
OF RN DESIGN LTD UNDER THE REGISTRATION 3.2.4
OF THE BUILDING ACT 1984. THE FIRM IS
REGISTERED.

PRELIMINARY-NOT
FOR CONSTRUCTION

SIGNATURE:

client		location	
Steve & Tina Vocella		VAUGHAN	
project		marketing name	
Detached Garage			
#	revisions	date	dwn
1	ISSUED FOR CLIENT REVIEW	14/09/18	EX
2	ISSUED FOR CLIENT REVIEW	28/09/18	MSA
3	REVISED AS PER HCD COMMENTS	5/04/19	MSA

RN design
Imagine - Inspire - Create

model
DETACHED GARAGE
scale
3/16" = 1'0"

page

D2

project #
18016

D3

